



# Heat Recovery Systems

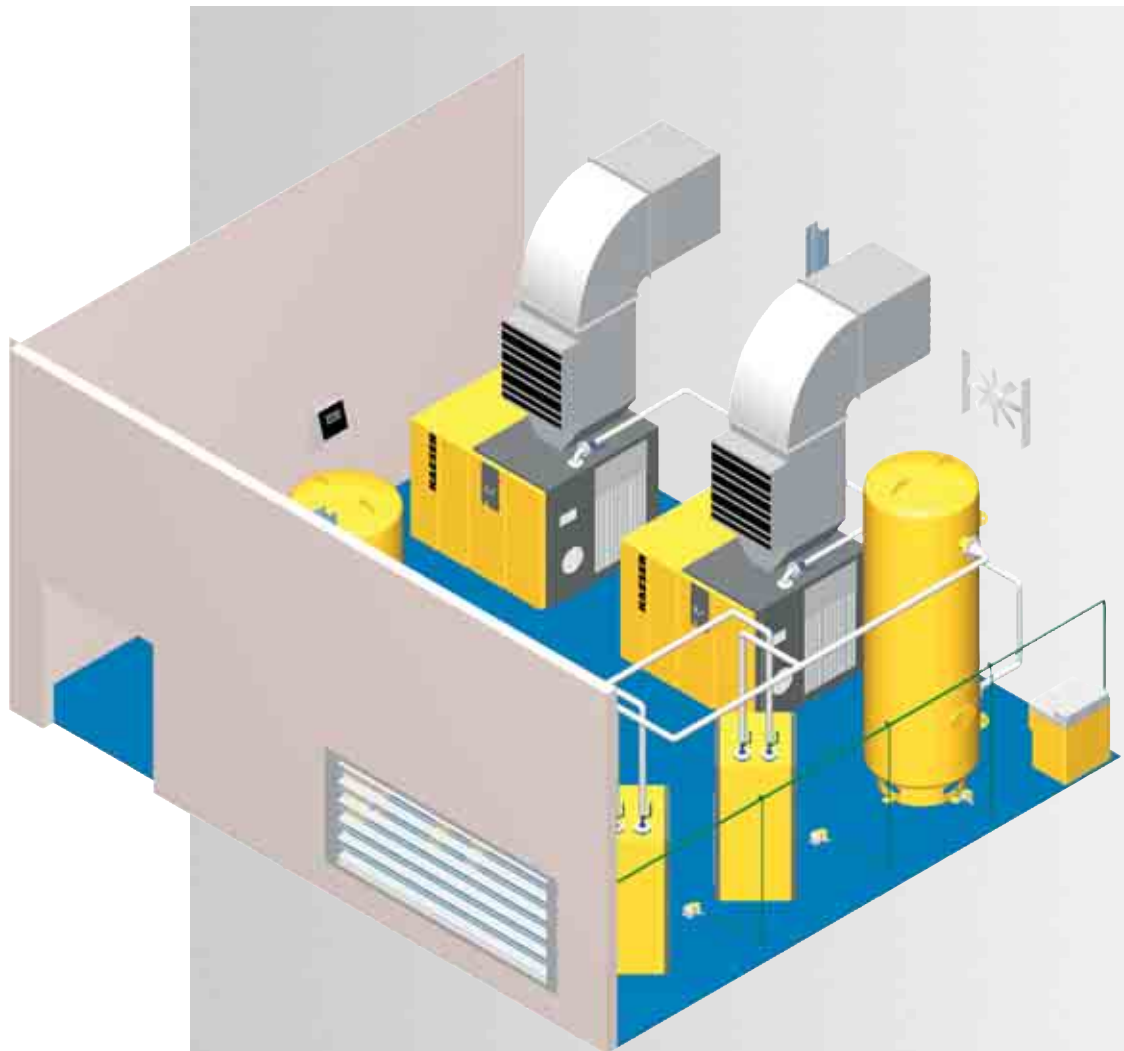

# Heat Flow Diagram

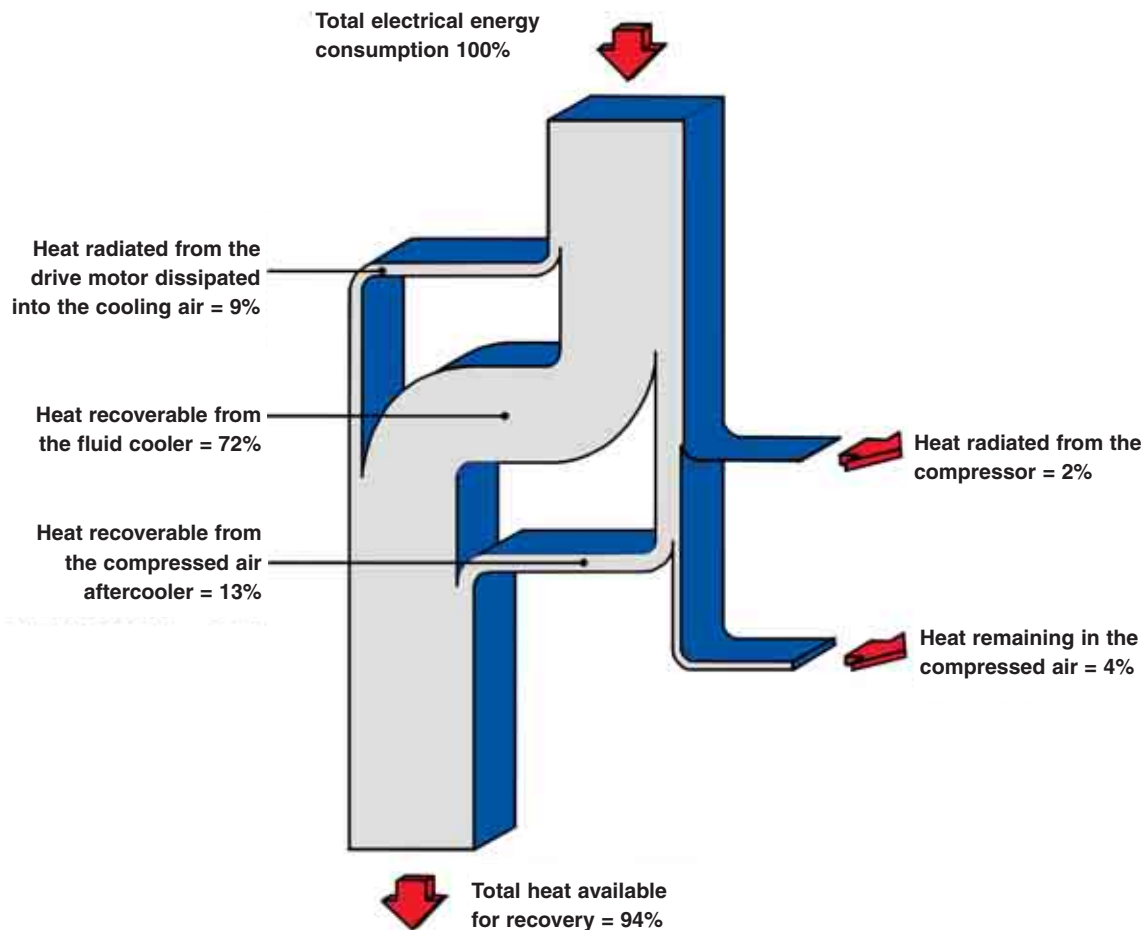

Almost all the electrical energy consumed by a compressor is changed into heat. On screw compressors, approximately 94% of this heat is given up to the cooling system, approximately 4% remains in the compressed air and approximately 2% is radiated from the compressor into the immediate surroundings.

Because the low cost of electricity was only a small part of operating costs in former years, waste was of no great concern and few considered making practical use of the heat produced by compression. Only since the dramatic increase in electricity costs has compressor heat recovery become an important factor in planning an efficient air system.

The basic principle lies in transferring of the heat into a medium and then transporting it to where the heat can be utilized.

The theoretical available heat of a screw compressor is 94% of the overall electrical energy consumption. It consists of heat dissipated in the fluid cooler (72%), the aftercooler (13%) and heat radiated from the drive motor (9%).


An enclosed, air-cooled screw compressor with a precisely defined cooling air outlet would transfer the total amount into the cooling air for space heating.

If water is to be heated, the oil in the fluid cooler is chosen as the transfer medium so that only 72% of the overall power consumption is available for water heating.

If a combination of hot water and space heating is chosen then a maximum of 72% is available for water heating and at least 22% for space heating.

The PTG and SWT systems are available as factory options shipped with your Kaeser compressor. Field retrofit kits are also available. Please contact your local Kaeser distributor for more information on these great energy saving systems.

# Space Heating

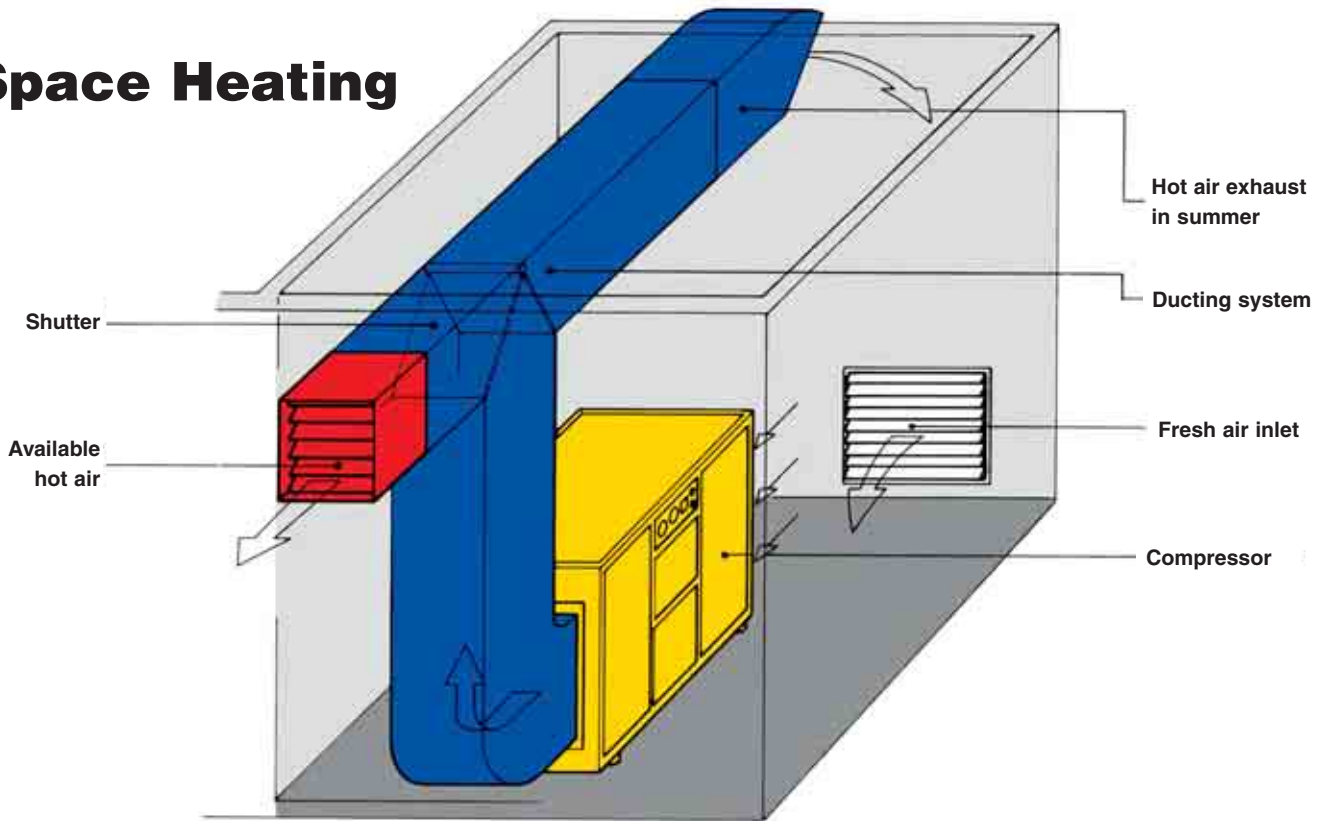

With their compact footprint and standard enclosure, Kaeser's rotary screw compressors are ideally suited for heat recovery applications. Up to 94% of the overall energy consumption from the cooling air can be ducted and redirected.

By applying conventional HVAC ductwork and controls, warm air from compressors can be channeled to remove or provide heat in the compressor room and adjacent areas as desired. Applications include auxiliary or primary heating for warehouses and workshops, drying air for paint spraying or washing, air curtains, and improving oil burner efficiency by heating the combustion air.

Screw Compressor Model	Motor (hp)	Typical Available Heat (BTU/hr)	Water Volume Heated to 158° (ΔT=99°F) Also useable for PTG system (gal/h)	Typical Savings in 2000 hr <sup>1</sup> (\$)
SX 3	3	8,652	650	386
SX 4	4	11,856	880	529
SX 6	5	15,702	880	701
SX 7	7.5	21,181	880	946
SM 7.5	7.5	22,431	1295	1001
SM 10	10	31,403	1295	1402
SM 15	15	41,017	1295	1831
SK 15	15	43,260	1530	1931
SK 20	20	53,193	1648	2375
AS 20	20	62,807	2118	2804
AS 25	25	75,304	2118	3362
AS 30	30	86,519	2354	3862
ASD 25	25	73,157	2649	3266
ASD 30	30	86,616	2649	3867
ASD 40S	40	106,098	2649	4737
ASD 40	40	122,281	3120	5459
BSD 40	40	121,063	4826	5405
BSD 50	50	148,269	4826	6619
BSD 60	60	182,011	4826	8125
CSD 60	60	180,409	5720	8054
CSD 75	75	217,580	5720	9713
CSD 100S	100	269,171	6474	12,017
CSD 100	100	319,801	7652	14,277
CSD 125	125	360,177	7652	16,079
DSD 100	100	304,228	6500	13,582
DSD 125	125	400,969	9400	17,900
DSD 150	150	477,363	9400	21,311
DSD 200	200	581,763	10,600	25,972
ESD 250	250	764,255	16,500	34,119
ESD 300	300	830,394	18,800	37,071
FSD 350	350	938,896	23,543	41,915
FSD 400	400	1,145,901	23,543	51,156
FSD 450	450	1,172,819	23,543	52,358
GS 525	400	118,471	8828	5289
GS 590	425	125,213	8828	5590
GS 620	450	132,578	8828	5919
GS 650	475	139,944	8828	6248
HS 670	500	146,538	17,657	6542
HS 690	535	156,796	17,657	7000
HS 760	605	176,387	17,657	7874


<sup>(1)</sup> Heating value of fuel oil: 128,000 BTU/gal

1 hp = 2545 BTU/hr

Heating efficiency: 0.70 Heating oil costs: \$2.00/gal

Convection and internal heat losses are not accounted for

# PTG Water Heating System

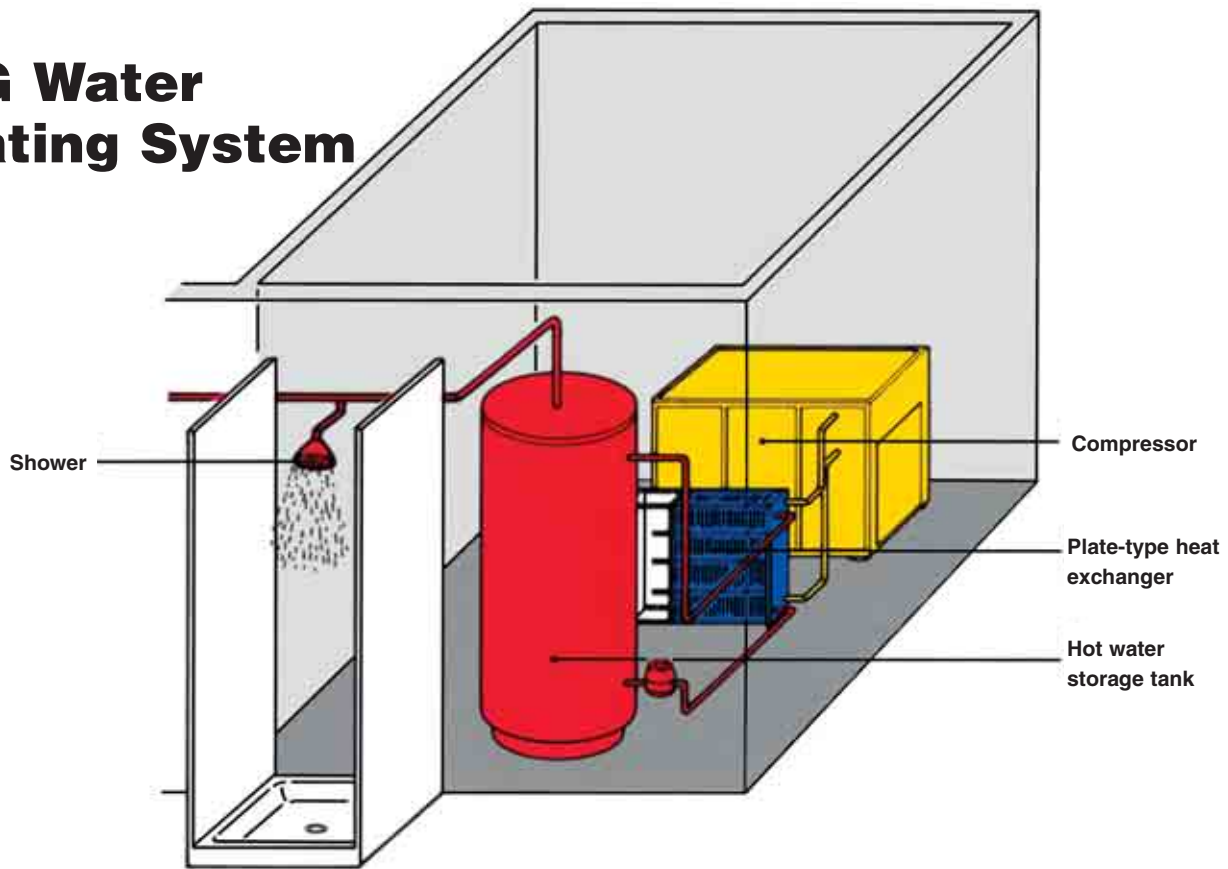

The PTG heat exchanger consists of a stack of up to 200 individually stamped stainless steel plates. The plate profile generates a highly turbulent flow within the channels to ensure efficient heat transfer. Every alternate plate is fitted at 180° to the next, providing innumerable contact points right across the heat exchanging surface. The heat exchanger is brazed in a vacuum oven using 99.9% pure copper.

Because of the high temperatures possible (around 180°F) the system is enclosed in a frame to prevent injury through contact.

If little or no hot water is needed, the compressor cooling fluid flow is automatically directed through the standard fluid cooler. Constant compressor cooling is ensured whether hot water is required or not.


The system can be easily integrated in any hot water supply plant, especially where it is desirable to avoid mixing water and cooling fluid.

Screw Compressor Model	Motor (hp)	Typical Available Heat (BTU/hr)	Water Volume Heated to 158° (ΔT=99°F) Also useable for PTG system (gal/h)	Typical Savings in 2000 hr <sup>1</sup> (\$)
ASD 25	25	54,816	146	2,447
ASD 30	30	65,725	175	2,934
ASD 40S	40	81,542	217	3,640
ASD 40	40	94,087	251	4,200
BSD 40	40	91,360	244	4,079
BSD 50	50	113,450	302	5,065
BSD 60	60	154,903	413	6,915
CSD 60	60	139,086	371	6,209
CSD 75	75	168,539	449	7,524
CSD 100S	100	209,992	560	9,375
CSD 100	100	249,263	664	11,128
CSD 125	125	285,534	761	12,747
DSD 100	100	220,355	587	9,837
DSD 125	125	316,897	845	14,147
DSD 150	150	379,076	1010	16,923
DSD 200	200	468,800	1249	20,929
ESD 250	250	612,249	1632	27,333
ESD 300	300	670,338	1787	29,926
FSD 350	350	799,060	2130	35,672
FSD 400	400	975,235	2599	43,537
FSD 450	450	998,143	2660	44,560
GS 525	400	814,080	2168	36,343
GS 590	425	864,960	2304	38,614
GS 620	450	915,840	2439	40,886
GS 650	475	966,720	2575	43,157
HS 670	500	1,017,600	2710	45,429
HS 690	535	1,088,832	2900	48,609
HS 760	605	1,231,296	3279	54,969

<sup>(1)</sup> Heating value of fuel oil: 128,000 BTU/gal  
 Heating efficiency: 0.70  
 Heating oil costs: \$2.00/gal  
 Heat exchanger efficiency is not considered

1 hp = 2545 BTU/h

# SWT Water Heating System

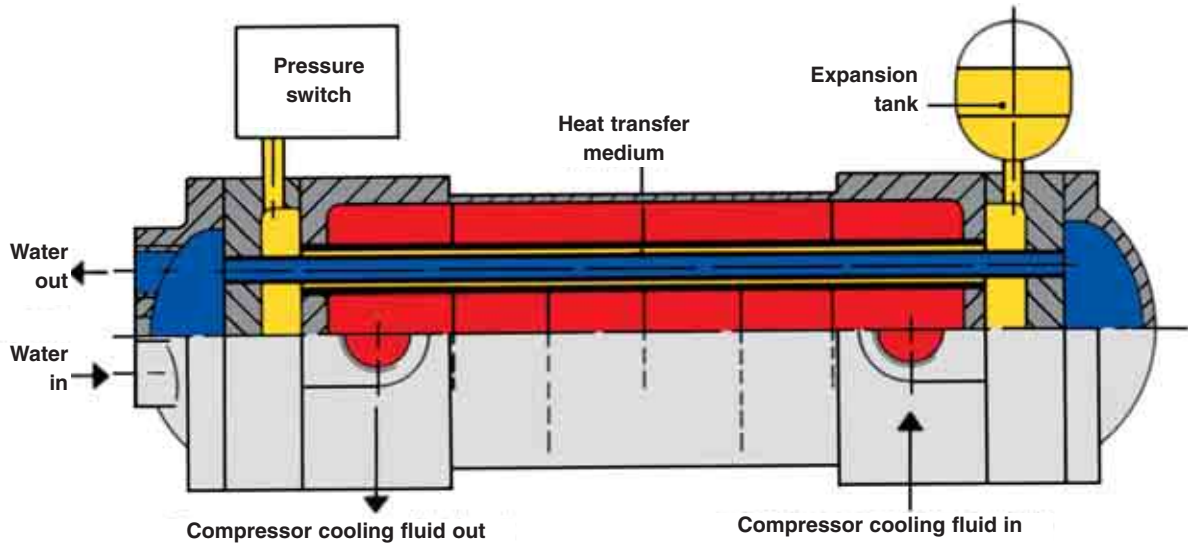

In the SWT fail-safe heat exchanger one tube is fitted into another such that a space still exists between the two tubes. Both tubes are individually pressed into separate tube end plates. The space is filled with a harmless heat transfer medium kept at a constant pressure by the expansion tank. This pressure is continuously monitored by a pressure switch.

In case of breakage or corrosion, either water or compressor cooling fluid mixes with the heat transfer medium and the pressure increases, actuating the pressure switch, giving an alarm or shutting down the compressor. Contamination of either fluid or water is impossible. The fail-safe heat exchanger is piped exactly the same as the PTG plate-type heat exchanger and can produce hot water at about 158°F.

If little or no hot water is needed, the cooling fluid flow is automatically directed through the standard cooler of the compressor. Constant compressor cooling is ensured whether hot water is required or not.

Screw Compressor Model	Motor (hp)	Typical Available Heat (BTU/hr)	Water Volume Heated to 158° (ΔT=99°F) Also useable for PTG system (gal/h)	Typical Savings in 2000 hr <sup>1</sup> (\$)
ASD 25	25	54,816	66	2,447
ASD 30	30	65,725	80	2,934
ASD 40S	40	81,542	99	3,640
ASD 40	40	94,087	114	4,200
BSD 40	40	91,360	111	4,079
BSD 50	50	113,450	137	5,065
BSD 60	60	154,903	188	6,915
CSD 60	60	139,086	169	6,209
CSD 75	75	168,539	204	7,524
CSD 100S	100	209,992	254	9,375
CSD 100	100	249,263	302	11,128
CSD 125	125	285,534	346	12,747
DSD 100	100	220,355	267	9,837
DSD 125	125	316,897	384	14,147
DSD 150	150	379,076	459	16,923
DSD 200	200	468,800	568	20,929
ESD 250	250	612,249	742	27,333
ESD 300	300	670,338	812	29,926
FSD 350	350	799,060	968	35,672
FSD 400	400	975,235	1181	43,537
FSD 450	450	998,143	1209	44,560
GS 525	400	814,080	986	36,343
GS 590	425	864,960	1047	38,614
GS 620	450	915,840	1109	40,886
GS 650	475	966,720	1170	43,157
HS 670	500	1,017,600	1232	45,429
HS 690	535	1,088,832	1318	48,609
HS 760	605	1,231,296	1491	54,969

(1) Heating value of fuel oil: 128,000 BTU/gal  
 Heating efficiency: 0.70  
 Heating oil costs: \$2.00/gal  
 Heat exchanger efficiency is not considered

1 hp = 2545 BTU/h



Kaeser's U.S. headquarters in Fredericksburg, Virginia

### Mission Statement

We strive to earn our customer's trust by supplying high quality Kaeser air compressors, related compressed air equipment and premium blower systems. Our products are designed for reliable performance, easy maintenance, and energy efficiency. Prompt and dependable customer service, quality assurance, training, and engineering support contribute to the value our customers have come to expect from Kaeser. Our employees are committed to implementing and maintaining the highest standards of quality to merit customer satisfaction. We aim for excellence in everything we do.

Our engineers continue to refine manufacturing techniques and take full advantage of the newest machining innovations. Extensive commitment to research and development keeps our products on the leading edge of technology to benefit our customers.



**Built for a lifetime.™**

Corporate Headquarters:  
P.O. Box 946  
Fredericksburg, Virginia 22404  
Phone 540-898-5500  
Fax 540-898-5520  
www.kaeser.com

Certified Management Systems



Member of



www.cagi.org

## The Air Systems Specialist

With over 85 years of experience, Kaeser is the air systems specialist. Our extensive 100,000 square foot facility allows us to provide unequaled product availability. With service centers nationwide and our 24-hour emergency parts guarantee, Kaeser customers can rely on the best after-sales support in the industry. Kaeser stands committed to providing the highest quality air system for your specific compressed air needs.

